



ALSEAL MARKETING SDN. BHD. Co.No.: 200301022720 (625140-D)

No. 86, Jalan Industri 3/3, Rawang Integrated Industrial Park, 48000 Rawang, Selangor.

Tel: +603-6094 2088 Fax: +603-6099 2930 Email: info@alsealmarketing.com

Website: www.alsealmarketing.com

Our reference: 20/J20/LTR/Y416

20th October 2020

Dear Valued Customer / Business Partners,

RE: "ALSEAL" AS-208 Glass & Metal Sealant - Product Performance

This is to confirm that the product performance of **"ALSEAL" AS-208 Glass & Metal Sealant** has been tested by ISO/IEC 17025 accredited independent third-party testing labs. The following standards were used to test the performance of AS-208:

Test standard	Description	Report No.
ASTM C920	Standard Specification for Elastomeric Joint Sealants	7191241115- MEC20/02A-ED & 7191241115- MEC20/2B-KSY

Conclusion

AS-208 is classified as a **Type S** (single-component sealant), **Grade NS** (non-sag sealant), **Class 25** ($\pm 25\%$ movement), Use **NT** (non-traffic), **A** (aluminium), **G** (glass) according to ASTM C920.

Should you require further information concerning the above product, please do not hesitate to contact us.

Thank you

Yours sincerely,

For Alseal Marketing Sdn. Bhd.

Prepared by: Yap Wai Hoong
(R&D Chemist)

Verified by: Alex Ng
(General Manager (Technical))

Test Report No. 7191241115-MEC20/02A-ED (221419610)
dated 9 Oct 2020



PSB Singapore

Add value.
Inspire trust.

Note: This report is issued subject to the Testing and Certification Regulations of the TÜV SÜD Group and the General Terms and Conditions of Business of TÜV SÜD PSB Pte Ltd. In addition, this report is governed by the terms set out within this report.

SUBJECT:

Testing of sealant submitted by Vital Technical Sdn Bhd

TESTED FOR:

Alseal Marketing Sdn Bhd
No. 86, Jalan Industri 3/3
Rawang Integrated Industrial Park
48000 Rawang
Selangor Darul Ehsan
Malaysia

Attn: Mr Cheong Chee Leong

SAMPLE DESCRIPTION:

The following items were received as shown:

Sample	Size	Quantity	Date received
'AS-208 Glass & Metal Sealant'	300 ml/cartridge	2 cartridges	15 Jul 2020
		8 cartridges	22 Jul 2020

TEST METHODS:



Adopted ASTM C920 : 2018 Standard Specification For Elastomeric Joint Sealants

Staining And Colour Change, UV Exposure

- Adopted ASTM C510 : 2016 Standard Test Method For Staining And Colour Change Of Single Or Multi-Component Joint Sealants

Test equipment : QUV Weatherometer
Lamp designation : Fluorescent UVA 340 mm
Test cycle : 8 hours UV exposure at 55°C and 4 hours condensation at 45°C (ASTM G154)
Exposure duration : 100 hours
No. of determinations : 4 samples: 2 samples with sealant and 2 samples without sealant (For UV Exposure)
2 control samples: 1 sample with sealant and 1 sample without sealant (Standard Conditions)



 	LA-2007-0380-A LA-2007-0381-F LA-2007-0382-B LA-2007-0383-G LA-2007-0384-G LA-2007-0385-E	LA-2007-0386-C LA-2010-0464-D LA-2018-0702-B LA-2018-0703-G LA-2020-0747-L	The results reported herein have been performed in accordance with the terms of accreditation under the Singapore Accreditation Council. Inspections/Calibrations/Tests marked "Not SAC-SINGLAS Accredited" in this Report are not included in the SAC-SINGLAS Accreditation Schedule for our inspection body/laboratory.
---	--	--	---

Laboratory:
TÜV SÜD PSB Pte. Ltd.
No.1 Science Park Drive
Singapore 118221

Phone : +65-6885 1333
Fax : +65-6776 8670
E-mail: enquiries@tuvsud.com
https://www.tuvsud.com/en-sg
Co. Reg : 199002667R

Regional Head Office:
TÜV SÜD Asia Pacific Pte. Ltd.
1 Science Park Drive, #02-01
Singapore 118221
TUV®



Staining And Colour Change, Standard Conditions In Distilled Water

Test apparatus : Container with distilled water
Test condition : Distilled water immersion for 1 minute, once a day,
(5 days per week)
Test duration : 14 days
No. of determinations : 2 samples: 1 sample with sealant and 1 sample
without sealant (For distilled water immersion)
2 control samples: 1 sample with sealant and 1 sample
without sealant (Standard Conditions)

Extrudability

2. Adopted ASTM C1183/C1183M : 2013 (2018) Standard Test Method For Extrusion Rate Of Elastomeric Sealants

Test pressure : 40 psi
No. of determination : 1

Flow Properties

3. ASTM C639 : 2015 Standard Test Method For Rheological (Flow) Properties Of Elastomeric Sealants

Method : Test method for 'Type II' sealant
Test conditions : a) 4.4°C in environmental chamber for 4 hours
b) 50°C in oven for 4 hours
No. of determinations : 2 for vertical and horizontal displacements

Hardness

4. ASTM C661 : 2015 Standard Test Method For Indentation Hardness Of Elastomeric-Type Sealants By Means Of A Durometer

Test Conditions:

a) 23°C and 50% relative humidity for 7 days
b) 38°C and 95% relative humidity for 7 days
c) 23°C and 50% relative humidity for 7 days
No. of determinations : 2, 3 points per test piece

Tack-Free Time

5. ASTM C679 : 2015 Standard Test Method For Tack-Free Time Of Elastomeric Sealants

No. of determinations : 2

Ed



Cyclic Adhesion & Cohesion

6. Adopted ASTM C719 : 2014 (2019) Standard Test Method For Adhesion And Cohesion Of Elastomeric Joint Sealants Under Cyclic Movement (Hockman Cycle)

Test Conditions:

- a) 23°C and 50% relative humidity for 7 days
- b) 38°C and 95% relative humidity for 7 days
- c) 23°C and 50% relative humidity for 7 days
- d) Immersion in distilled water at 23°C for 7 days
- e) Drying in oven at 70°C for 7 days

Substrate : Aluminium and glass
Test temperature : Room temperature
No. of determinations : 3 for class 25 per substrate

Effects Of Heat Ageing

7. ASTM C1246 : 2017 Standard Test Method For Effects Of Heat Ageing On Weight Loss, Cracking, And Chalking Of Elastomeric Sealants After Cure

Test Conditions:

- a) 23°C and 50% relative humidity for 28 days
 - b) 70°C for 21 days
- No. of determinations : 3, 1 as control

Effects Of Accelerated Weathering

8. Adopted ASTM C793 : 2005 (2017) Standard Test Method For Effects Of Accelerated Weathering On Elastomeric Joint Sealants

Test Conditions:

23°C and 50% relative humidity for 21 days

Test equipment : QUV Weatherometer
Test cycle : 8 hours UV exposure at 55°C and 4 hours condensation at 45°C (ASTM G154)
Lamp designation : Fluorescent UVA 340 mm
Exposure duration : 250 hours
No. of determinations : 3 (1 as control)
Bend test
Apparatus : Steel mandrel
Test condition : -26°C for 24 hours
No. of determinations : 3

Ed



Adhesion-In-Peel

9. Adopted ASTM C794 : 2018 Standard Test Method For Adhesion-In-Peel Of Elastomeric Joint Sealants

Test Conditions:

23°C and 50% relative humidity for 21 days
Substrate : Aluminium and glass
Crosshead speed : 50 mm/min
No. of determinations : 4 per substrate

CONDITIONING:

Unless otherwise specified, all test specimens were tested at 23 ± 2°C and 50 ± 5% relative humidity. Standard Conditions parameters: 23 ± 2°C and 50 ± 5% relative humidity.

TEST RESULTS:

Test	'AS-208 Glass & Metal Sealant'	ASTM C920 : 2018 Standard Specification For Elastomeric Joint Sealants
1. Staining And Colour Change	No staining No colour change	The sealant shall not cause any visible stain on the top surface of a white cement mortar base
2. Extrudability	516.9 ml/min	Type S (single component), grade NS (non-sag or gunnable sealant) shall have an extrusion rate of not less than 10 ml/min
3. Rheological (Flow) Properties	Vertical displacement: 0 mm sag Horizontal displacement: No deformation	Grade NS (non-sag) or gunnable sealant shall have flow characteristics such that it does not sag more than 4.8 mm (³ / ₁₆ in.) in vertical displacement. Also the sealant shall show no deformation in horizontal displacement (refer to Types II and IV in the tests)
4. Indentation Hardness	test piece 1, average : 23.9 test piece 2, average : 24.1 average of 2 test pieces : 24.0	Use T1 (traffic) sealant shall have a hardness reading, after being properly cured, of not less than 25 Use T2 (traffic) sealant shall have a hardness reading, after being properly cured, of less than 25 Use NT (non-traffic) sealant shall have a hardness reading, after being properly cured, of less than 60
5. Tack-Free Time	No transfer of test specimens to the polyethylene film	There shall be no transfer of the sealant to the polyethylene film when tested at 72 hours

Ed





TEST RESULTS:

Test	'AS-208 Glass & Metal Sealant'	ASTM C920 : 2018 Standard Specification For Elastomeric Joint Sealants
6. Adhesion & Cohesion Under Cyclic Movement, Class 25 a. aluminium b. glass	No loss in bond No loss in bond	The total loss in bond and cohesion areas among the three specimens tested for each surface shall be no more than 9 cm ² (1½ in. ²) with standard mortar, glass, and aluminium or any other specified substrates
7. Effects Of Heat Ageing On Weight Loss, Cracking And Chalking, average	1.0% No cracking and chalking	The sealant shall not lose more than >7% of its original weight or show any cracking and chalking
8. Effects Of Accelerated Weathering	No cracks after UV exposure and bend test	The sealant shall show no cracks greater than those shown in example #2 of Figure 1 in ASTM C793 after the specified UV exposure and shall show no cracks greater than those shown in example #2 of Figure 2 in ASTM C793 after exposure at cold temperature and the bend test (refer to Photo 2)
9. Adhesion-In-Peel, average a. aluminium b. glass	54.2 N (12.2 lbf) 56.8 N (12.8 lbf) cohesive failure within the sealant and no adhesive bond loss between sealant and substrate for each test piece	The peel strength for each individual test shall not be less than 22.2 N (5 lbf) when tested with standard mortar, glass, and aluminium or any other specified substrate. In addition, the sealant shall show no more than 25% adhesive bond loss for each individual test


REMARKS:

- The test conditions for staining and colour change tests and effects of accelerated weathering test were adopted from ASTM G154 : 2016 Standard Practice For Operating Fluorescent Light Apparatus For UV Exposure Of Non-Metallic Materials.
- For effects of accelerated weathering test, in ASTM C793, Photo 2 consists of Figure 1 which indicate the presence of cracks after UV exposure and Figure 2 which indicate the presence of cracks after bend test.
- The substrates did not require priming before application of the sealant as specified by the client.
- The class and type of substrate are specified by the client for ASTM C719 joint movement and ASTM C794 peel strength tests.
- One cartridge was sent to other section for material identification/verification FTIR test.


Eddie Suwand
Testing Officer
Senior Associate Engineer



Fabien Tan
Engineer
Real Estate & Infrastructure
Mechanical Centre

ASTM C793 - 05 (2017)

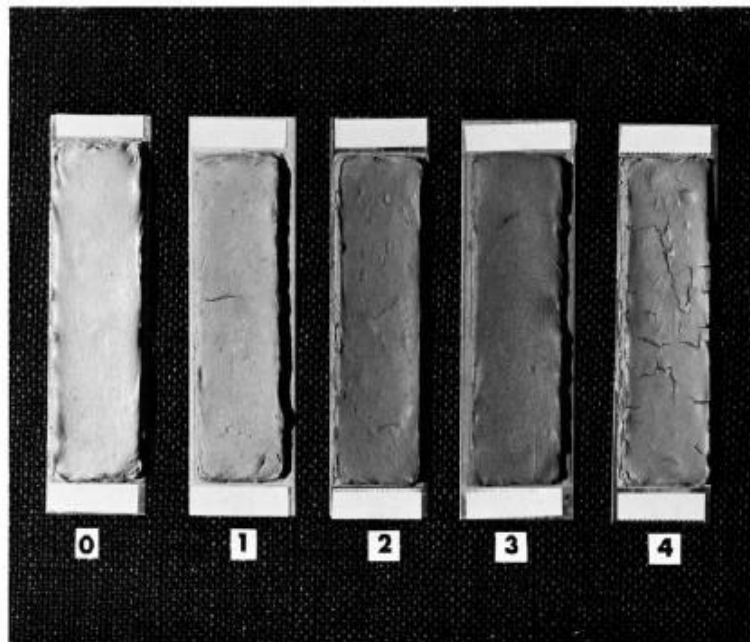

Note: 1—Number 0 represents no cracks.


FIG. 1 Examples of Cracking Obtainable After the Weathering Test

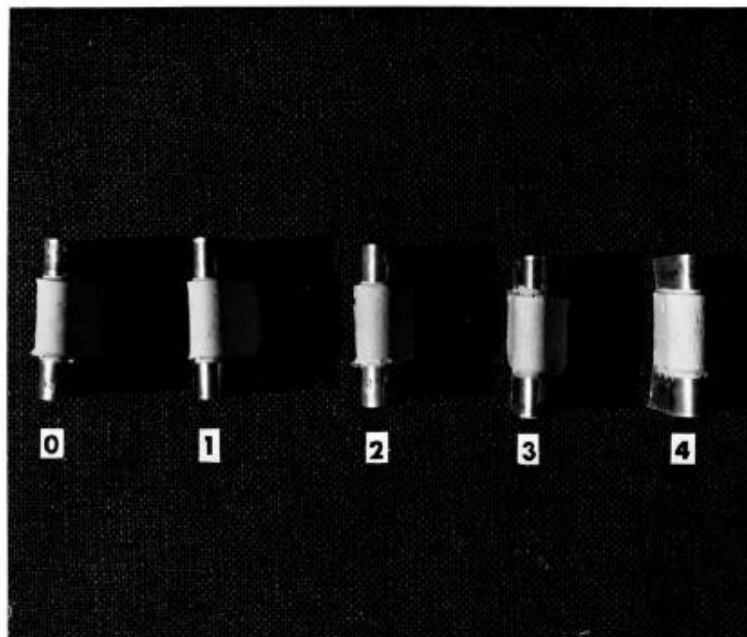

Note: 1—Number 0 represents no cracks.

FIG. 2 Examples of Cracking Obtainable After the Bend Test

Photo 2: Figures 1 and 2 showing presence of cracks after UV exposure and after bend test respectively
(taken from ASTM C793 as a guide and are not client's samples)






Please note that this Report is issued under the following terms :

1. This report applies to the sample of the specific product/equipment given at the time of its testing/calibration. The results are not used to indicate or imply that they are applicable to other similar items. In addition, such results must not be used to indicate or imply that TÜV SÜD PSB approves, recommends or endorses the manufacturer, supplier or user of such product/equipment, or that TÜV SÜD PSB in any way "guarantees" the later performance of the product/equipment. Unless otherwise stated in this report, no tests were conducted to determine long term effects of using the specific product/equipment.
2. The sample/s mentioned in this report is/are submitted/supplied/manufactured by the Client. TÜV SÜD PSB therefore assumes no responsibility for the accuracy of information on the brand name, model number, origin of manufacture, consignment or any information supplied.
3. Nothing in this report shall be interpreted to mean that TÜV SÜD PSB has verified or ascertained any endorsement or marks from any other testing authority or bodies that may be found on that sample.
4. This report shall not be reproduced wholly or in parts and no reference shall be made by the Client to TÜV SÜD PSB or to the report or results furnished by TÜV SÜD PSB in any advertisements or sales promotion.
5. Unless otherwise stated, the tests were carried out in TÜV SÜD PSB Pte Ltd, No.1 Science Park Drive Singapore 118221.
6. The tests carried out by TÜV SÜD PSB and this report are subject to TÜV SÜD PSB's General Terms and Conditions of Business and the Testing and Certification Regulations of the TÜV SÜD Group.

Effective 01 September 2020

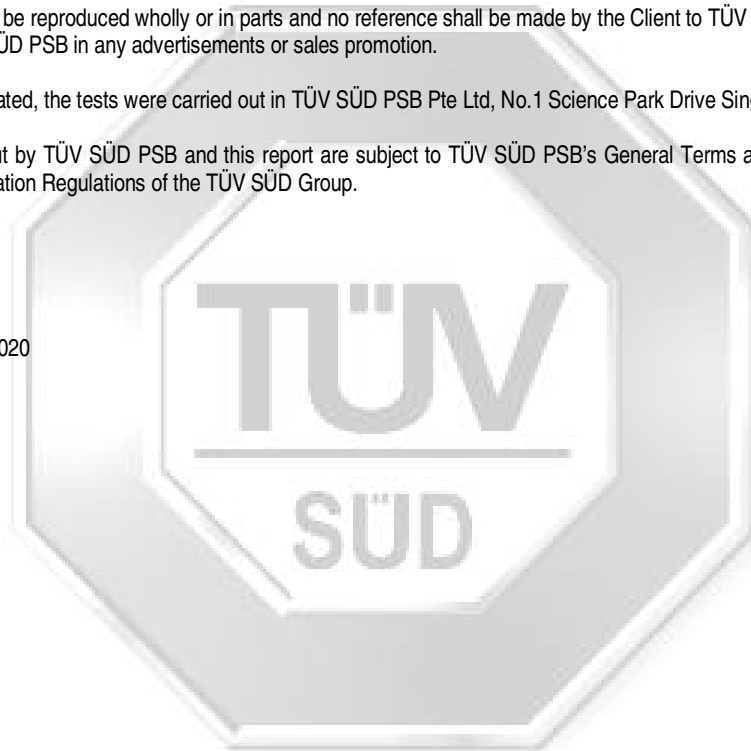

Test Report No. 7191241115-MEC20/2B-KSY (221419610)
dated 01 SEP 2020



PSB Singapore

Add value.
Inspire trust.

Note: This report is issued subject to the Testing and Certification Regulations of the TÜV SÜD Group and the General Terms and Conditions of Business of TÜV SÜD PSB Pte Ltd. In addition, this report is governed by the terms set out within this report.

SUBJECT:

Material Identification of 'AS-208' Glass & Metal Sealant

TESTED FOR:

Alseal Marketing Sdn. Bhd.
No. 86, Jalan Industri 3/3, Rawang Integrated Industrial Park,
48000 Rawang Selangor Darul Ehsan,
Malaysia

Attn: Mr Cheong Chee Leong

SAMPLE DESCRIPTION:

The following item with Brand : Alseal and Product Code : AS-208 was received on 29 July 2020 as shown:

Product Name	Size	Quantity
Glass & Metal Sealant	600 ml	1 sausage

TEST METHOD:

ASTM E1252 : 1998 (Reapproved 2013)

Standard Practice for General Techniques for Obtaining Infrared Spectra for Qualitative Analysis



Instrument used : Fourier Transform Infrared Spectrometer

DATE OF TEST:

13 August 2020



 	LA-2007-0380-A LA-2007-0381-F LA-2007-0382-B LA-2007-0383-G LA-2007-0384-G LA-2007-0385-E	LA-2007-0386-C LA-2010-0464-D LA-2018-0702-B LA-2018-0703-G LA-2020-0747-L	The results reported herein have been performed in accordance with the terms of accreditation under the Singapore Accreditation Council. Inspections/Calibrations/Tests marked "Not SAC-SINGLAS Accredited" in this Report are not included in the SAC-SINGLAS Accreditation Schedule for our inspection body/laboratory.
---	--	--	---

Laboratory:
TÜV SÜD PSB Pte. Ltd.
No.1 Science Park Drive
Singapore 118221

Phone : +65-6885 1333
Fax : +65-6776 8670
E-mail: enquiries@tuvsud.com
<https://www.tuvsud.com/en-sg>
Co. Reg : 199002667R

Regional Head Office:
TÜV SÜD Asia Pacific Pte. Ltd.
1 Science Park Drive, #02-01
Singapore 118221
TUV®



TEST RESULT:

Characteristic	'AS-208' Glass & Metal Sealant	ASTM C920 : 2018 Standard Specification For Elastomeric Joint Sealants
Material Identification	Closes match of silicone based material. (See Figure 1)	-


Kong Siew Yong
Testing Officer

Dr Hu Guangxia
Senior Consultant
Polymer Products
Mechanical Centre





Figure 1: Infrared Spectrum of 'AS-208' Glass & Metal Sealant

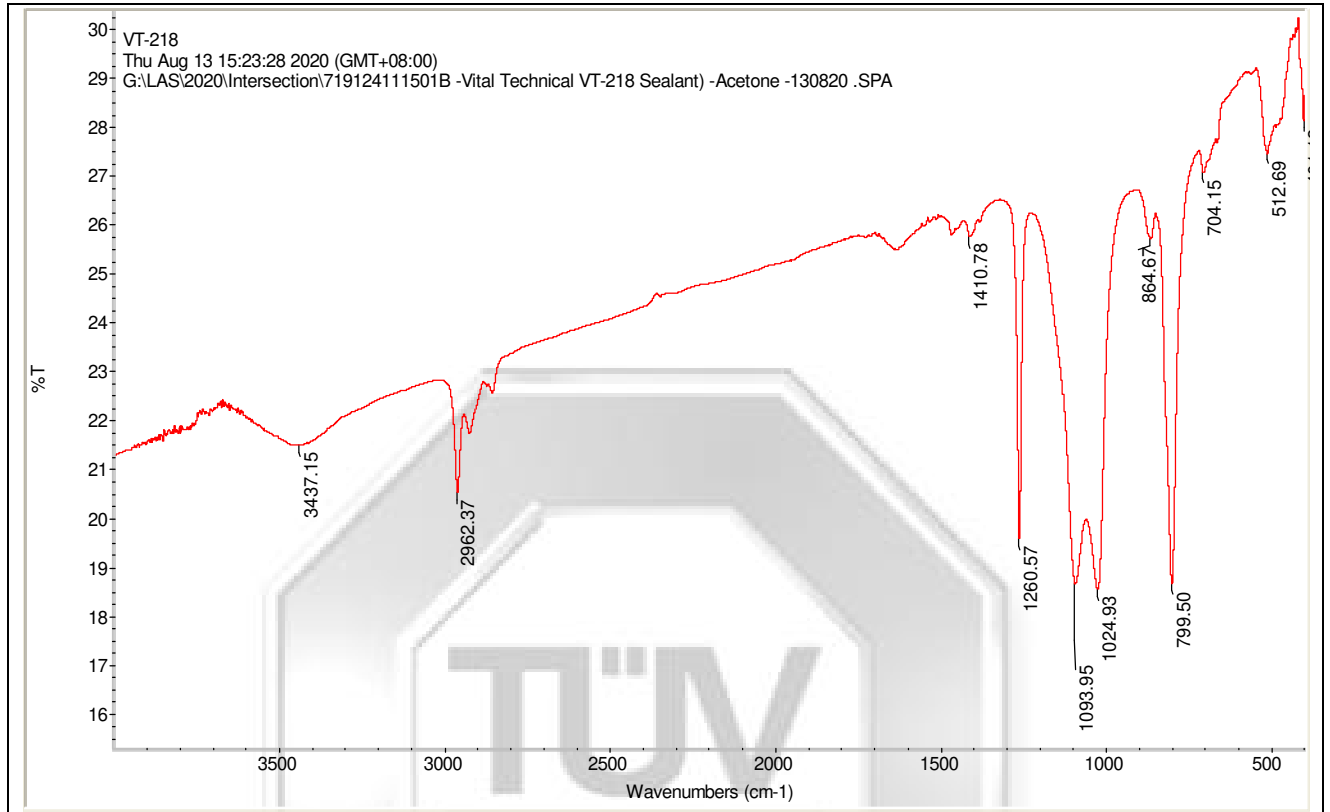

Hu Guangxia

Test Report No. 7191241115-MEC20/2B-KSY (221419610)
dated 01 SEP 2020



PSB Singapore

Please note that this Report is issued under the following terms :

1. This report applies to the sample of the specific product/equipment given at the time of its testing/calibration. The results are not used to indicate or imply that they are applicable to other similar items. In addition, such results must not be used to indicate or imply that TÜV SÜD PSB approves, recommends or endorses the manufacturer, supplier or user of such product/equipment, or that TÜV SÜD PSB in any way "guarantees" the later performance of the product/equipment. Unless otherwise stated in this report, no tests were conducted to determine long term effects of using the specific product/equipment.
2. The sample/s mentioned in this report is/are submitted/supplied/manufactured by the Client. TÜV SÜD PSB therefore assumes no responsibility for the accuracy of information on the brand name, model number, origin of manufacture, consignment or any information supplied.
3. Nothing in this report shall be interpreted to mean that TÜV SÜD PSB has verified or ascertained any endorsement or marks from any other testing authority or bodies that may be found on that sample.
4. This report shall not be reproduced wholly or in parts and no reference shall be made by the Client to TÜV SÜD PSB or to the report or results furnished by TÜV SÜD PSB in any advertisements or sales promotion.
5. Unless otherwise stated, the tests were carried out in TÜV SÜD PSB Pte Ltd, No.1 Science Park Drive Singapore 118221.
6. The tests carried out by TÜV SÜD PSB and this report are subject to TÜV SÜD PSB's General Terms and Conditions of Business and the Testing and Certification Regulations of the TÜV SÜD Group.

Effective 01 September 2020

